

### Description


Chimney draught regulator decreases too high pressure in smোক chimney duct, which:

- appears despite correct cross-section of a chimney duct,
- appears if the cross-sectional area of chimney duct is too big,
- is caused by temporary impact of weather conditions for example strong wind.

Device is destined to be mounted:

- on the connector which connects stove with the chimney,
- over the connector,
- under the connector.

### Construction

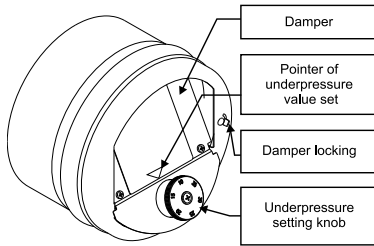

### Technical data

Type	RCO / RCO-EX RCW / RCR / RCP		RCO-80	
Group	5		1	
Norm	PN-EN 16475-3		PN-EN 16475-3	
Underpressure range [Pa]	10 ÷ 35		10 ÷ 35	
Max. fumes temp. [°C]	400		400	
Max. chimney duct cross-section [cm <sup>2</sup> ]	500 *	750 *	160 *	220 *
Max. diameter of a round chimney duct [cm]	25 *	31 *	14 *	16 *
Insulation class	I, II	III	I, II	III

\* Chimney parameters (chimney height not bigger than 20m)

### Functioning



The weight on the damper of draught regulator is balanced. When in a chimney duct the negative pressure rises too high, damper opens and lets fresh air in.

Thanks to this, pressure decreases because:


- fumes are cooler and in consequence the draught is smaller
- chimney duct apart from fumes must conduct fresh air supplied by the damper, so there is a substantial increase of the air resistance.

Changing the pressure settings on the draught regulator is made by screwing the damper balance (with its knob). On this knob there is a scale to set the negative pressure value, and on the label on the damper there is a mark showing the actual value set.

### Placing

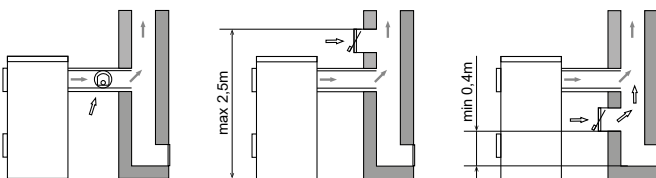

Damper closed




Damper opened

### REMARKS

- Draught regulator must be located in the same room as the heating device.
- Draught regulator must be mounted in a room where there is a properly functioning natural air supply ventilation (must be an inlet of fresh air).
- Draught regulator must be at an adequate distance from easy flammable elements:
  - door frames and similar parts made of flammable materials: min. 20 [cm]
  - other parts which are made of or contain flammable materials: min: 40 [cm]
- It is forbidden to mount the draught regulator in room without natural ventilation!
- Afterburning in the connector pipe or in chimney ducts is unacceptable!
- Do not allow to arise a soot fire in the chimney!
- Draught regulator cannot be installed on the way of the smoke and cannot disturb fumes flow in any other way.

### Mounting positions


Regulator will work properly only if placed perfectly horizontal, like shown on the diagram above.

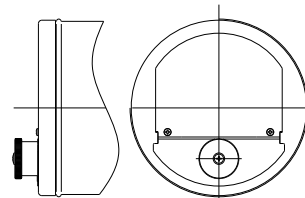

**Note!** Adjust negative pressure by rotating the knob on the regulator. Knob features "+" and "-" indicators. Turning the knob to the utmost "-" position (until resistance is felt) sets negative pressure at the value of 10 [Pa]. By making a half turn in the opposite direction, negative pressure is increased by 5 [Pa] (so to the value of 15 [Pa]), another half turn gives 20 [Pa] and then 25 [Pa] and 30 [Pa], respectively, up to the value of 35 [Pa], which is achieved by setting the knob to the utmost "+" position.

For reference, see the diagram on the product nameplate.

### 1. DRAUGHT REGULATOR TO DARCO CLEAN OUT ELEMENT RCW / RCW-S

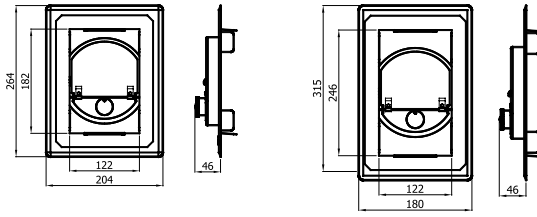

**RCW**

draught regulator to DARCO clean out element

**RCW-S**

draught regulator to clean out element of ceramic chimney


**Notice!** Mounting of the RCW regulator requires usage of the RM-DW door frame

Destination	S	S - flue ducts (gas, oil)
	D	D - smoke ducts
Material	X	X - stainless steel 1.4301

Weight [kg]	RCW	0.65
	RCWS	0.70

No	Name	Value		
1	Group	5		
2	Underpressure range [Pa]	10 ÷ 35		
3	Max fumes temp [°C]	400		
4	Chimney parameters (chimney height not bigger than 20 m)	Max chimney duct cross-section [cm <sup>2</sup> ]		
		I and II insulation class	500	25
		III insulation class	750	31

### 2. ON PIPE MOUNTED DRAUGHT REGULATOR RCR

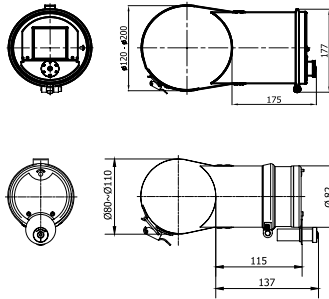

**RCR**

on pipe mounted draught regulator

**RCR-80**


on pipe mounted draught regulator

Destination	S	S - flue ducts (gas, oil)
	D	D - smoke ducts
Material	X	X - stainless steel 1.4301

Weight [kg]	RCR	0.65
	RCR-80	0.40

No	Name	Value		
1	Group	5		
2	Underpressure range [Pa]	10 ÷ 35		
3	Max fumes temp [°C]	400		
4	Chimney parameters (chimney height not bigger than 20 m)	Max chimney duct cross-section [cm <sup>2</sup> ]		
		I and II insulation class	500	25
		III insulation class	750	31

### 3. RECTANGULAR DRAUGHT REGULATOR RCP



**RCP**


rectangular draught regulator

Destination	S	S - flue ducts (gas, oil)
	D	D - smoke ducts
Material	X	X - stainless steel 1.4301

Weight [kg]	0.55
-------------	------

No	Name	Value		
1	Group	5		
2	Underpressure range [Pa]	10 ÷ 35		
3	Max fumes temp. [°C]	400		
4	Chimney parameters (chimney height not bigger than 20 m)	Max chimney duct cross-section [cm <sup>2</sup> ]		
		I and II insulation class	500	25
		III insulation class	750	31

### 4. ROUND DRAUGHT REGULATOR RCO

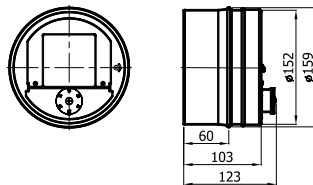

**RCO**

round draught regulator


**Caution!** Mounting clamp included

Destination	S	S - flue ducts (gas, oil)
	D	D - smoke ducts
Material	X	X - stainless steel 1.4301

Weight [kg]	0.60
-------------	------

No	Name	Value		
1	Group	5		
2	Underpressure range [Pa]	10 ÷ 35		
3	Max fumes temp. [°C]	400		
4	Chimney parameters (chimney height not bigger than 20 m)	Max chimney duct cross-section [cm <sup>2</sup> ]		
		I and II insulation class	500	25
		III insulation class	750	31

### 5. ROUND DRAUGHT REGULATOR WITH ANTI-EXPLOSION SYSTEM RCO-EX

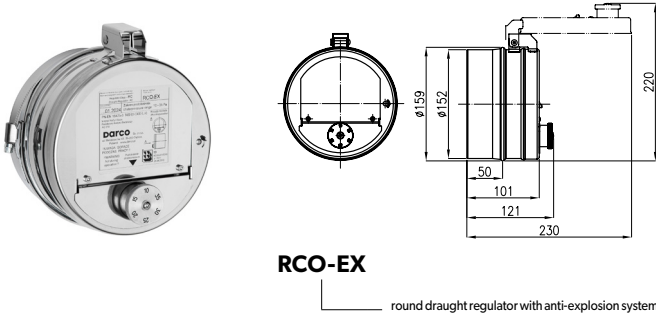



**Caution!** Mounting clamp included

Destination	S	S - flue ducts (gas, oil)
	D	D - smoke ducts
Material	X	X - stainless steel 1.4301

Weight [kg]	0.60
-------------	------

No	Name	Value	
1	Group	5	
2	Underpressure range [Pa]	10 ÷ 35	
3	Max fumes temp. [°C]	400	
4	Chimney parameters (chimney height not bigger than 20 m)	Max chimney duct cross-section [cm²]	Max diameter of a round chimney duct [cm]
	I and II insulation class	500	25
	III insulation class	750	31

### 6. ROUND DRAUGHT REGULATOR WITH REDUCER RCO

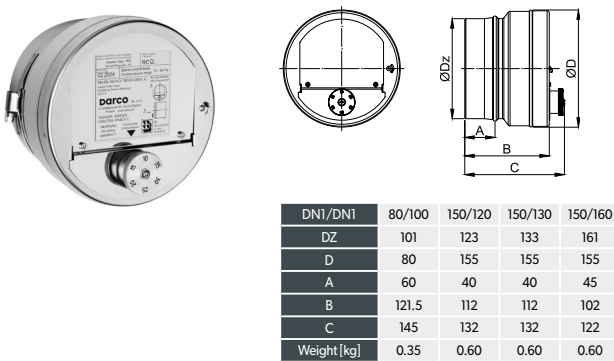


**Caution!** Mounting clamp included

Destination	S	S - flue ducts (gas, oil)
	D	D - smoke ducts
Material	X	X - stainless steel 1.4301

No	Name	Value	
1	Group	5	
2	Underpressure range [Pa]	10 ÷ 35	
3	Max fumes temp. [°C]	400	
RCO 80/100			
4	Chimney parameters (chimney height not bigger than 20 m)	Max chimney duct cross-section [cm²]	Max diameter of a round chimney duct [cm]
	I and II insulation class	160	14
	III insulation class	220	16
RCO 150/120, RCO 150/130, RCO 150/160			
5	Chimney parameters (chimney height not bigger than 20 m)	Max chimney duct cross-section [cm²]	Max diameter of a round chimney duct [cm]
	I and II insulation class	500	25
	III insulation class	750	31

### 7. ROUND DRAUGHT REGULATOR RCO-80

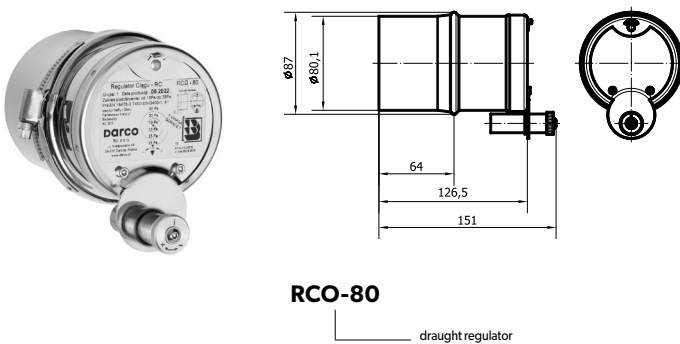


**Caution!** Mounting clamp included

Destination	S	S - flue ducts (gas, oil)
	D	D - smoke ducts
Material	X	X - stainless steel 1.4301

Weight [kg]	0.30
-------------	------


No	Name	Value	
1	Group	1	
2	Underpressure range [Pa]	10 ÷ 35	
3	Max fumes temp. [°C]	400	
4	Chimney parameters (chimney height not bigger than 20 m)	Max chimney duct cross-section [cm²]	Max diameter of a round chimney duct [cm]
	I and II insulation class	160	14
	III insulation class	220	16

**8. ON PIPE MOUNTED DRAUGHT REGULATOR SPK-2MM**



**RCO-150/+151-SPK**

on pipe mounted draught regulator SPK-2mm



**RCO-150/+156-SPK**

on pipe mounted draught regulator SPK-2mm

Destination	S	S - flue ducts (gas, oil)
	D	D - smoke ducts
Material	X	X - stainless steel 1.4301

Weight [kg]	0.50
-------------	------

No	Name	Value		
1	Group	5		
2	Underpressure range [Pa]	10 ÷ 35		
3	Max fumes temp. [°C]	400		
4	Chimney parameters (chimney height not bigger than 20 m)	Max chimney duct cross-section [cm <sup>2</sup> ]	Max diameter of a round chimney duct [cm]	
		I and II insulation class	500	25
		III insulation class	750	31